


ALARM PANEL FOR 2 ELECTRIC FIRE PUMP CONTROLLERS

Schematic

MODEL : APEE

BUILT TO UL 508A STANDARD.

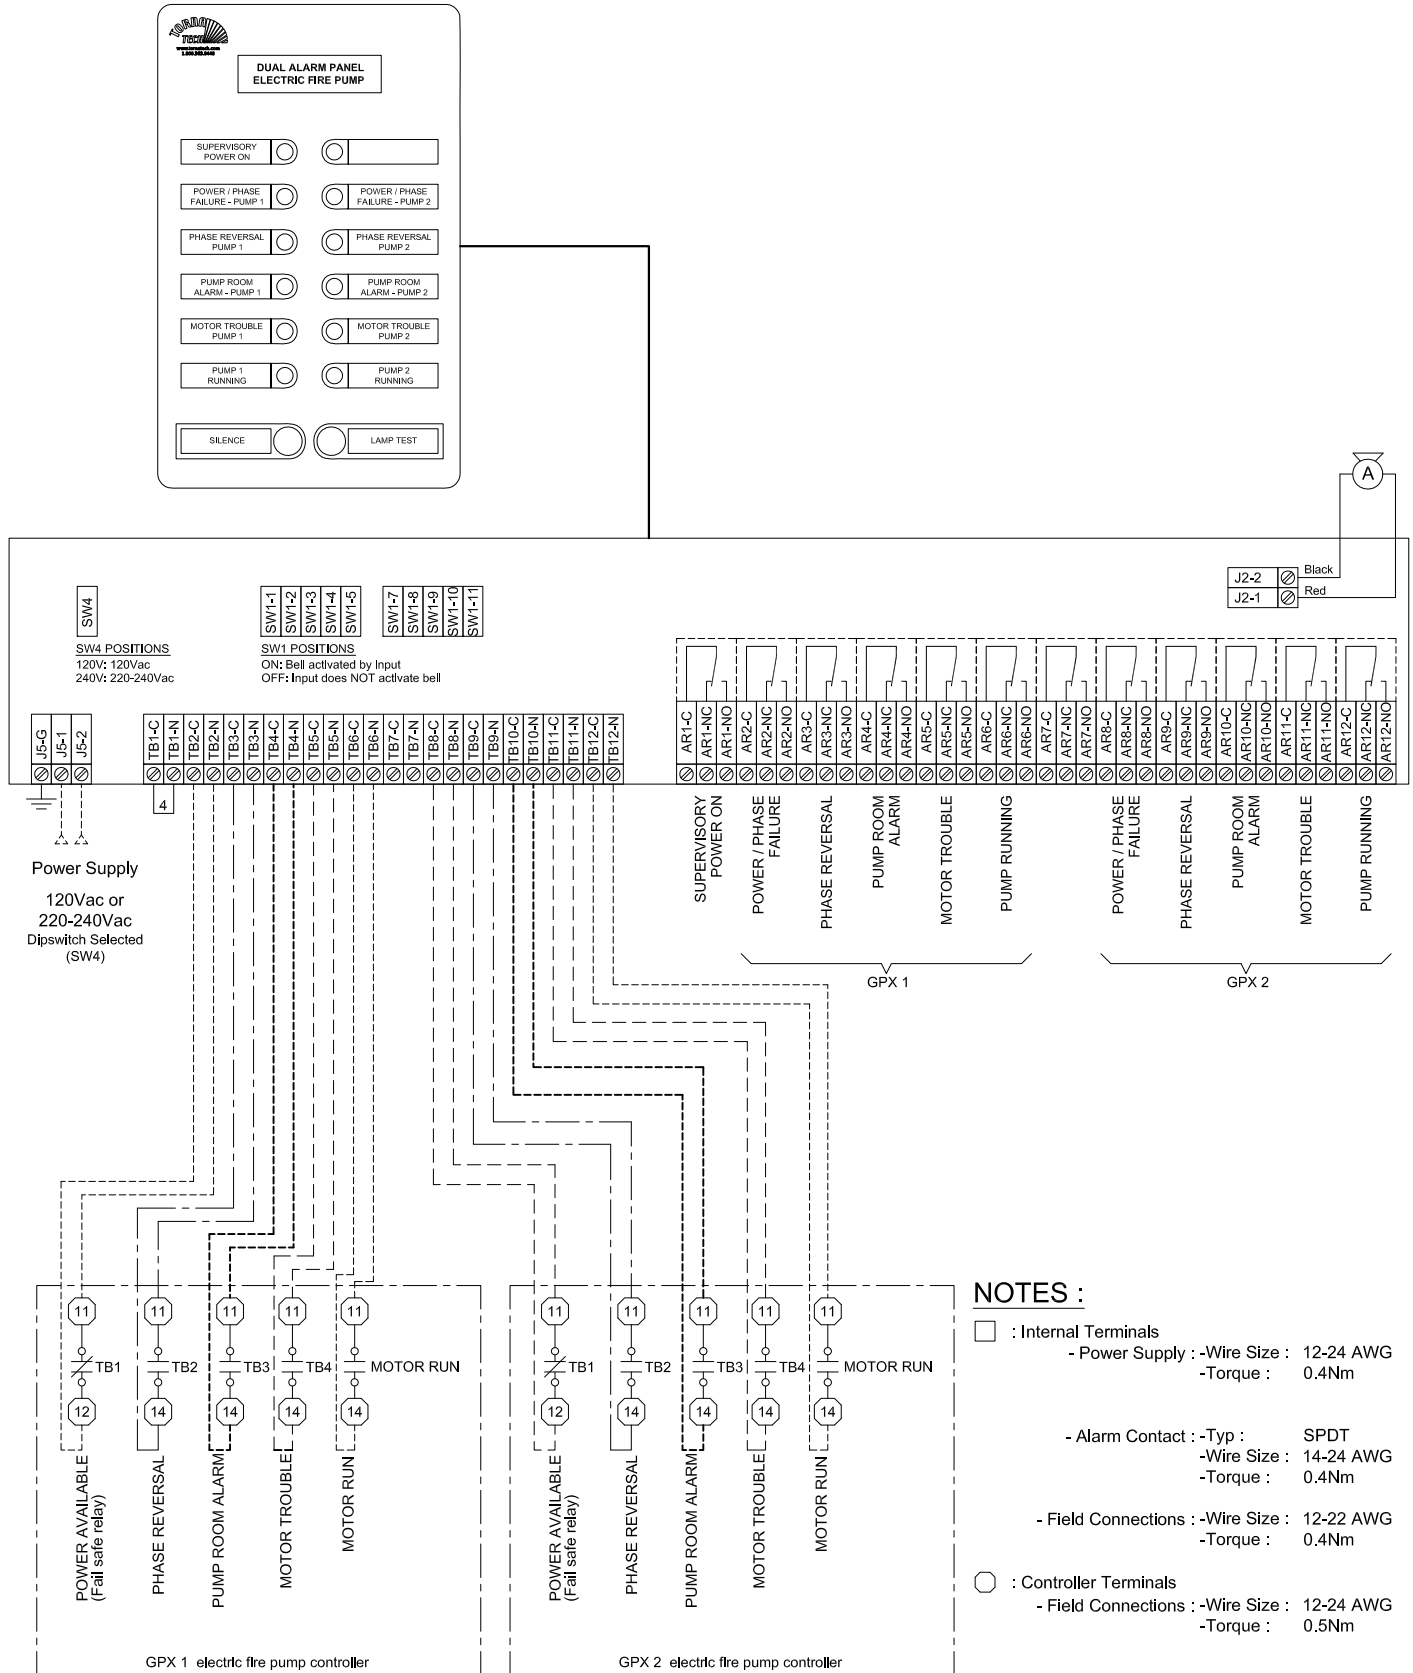

Drawing for Information only.
Manufacturer reserves the right to modify this drawing without notice.
For drawing for approval or installation, please contact manufacturer.



ISO 9001 REGISTERED



| REV. | DATE | DESCRIPTION | APP. |
|------|----------|------------------|--------|
| 1. | 20/08/13 | GENERAL REVISION | DES. |
| 0. | 06/03/12 | FIRST ISSUE | A VER. |



Drawing No.
APX-0019 1/2 /E

ALARM PANEL FOR 2 ELECTRIC FIRE PUMP CONTROLLERS

MODEL : APEE


Dimensions

BUILT TO UL 508A STANDARD.

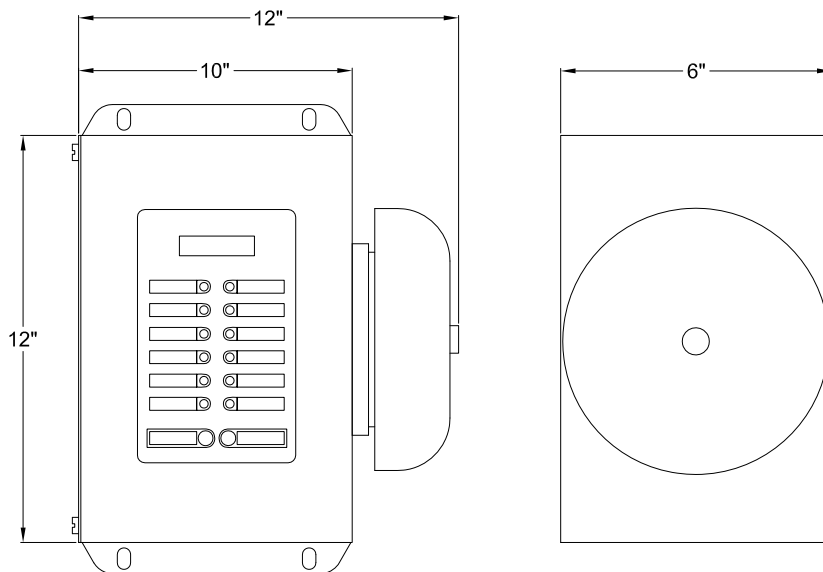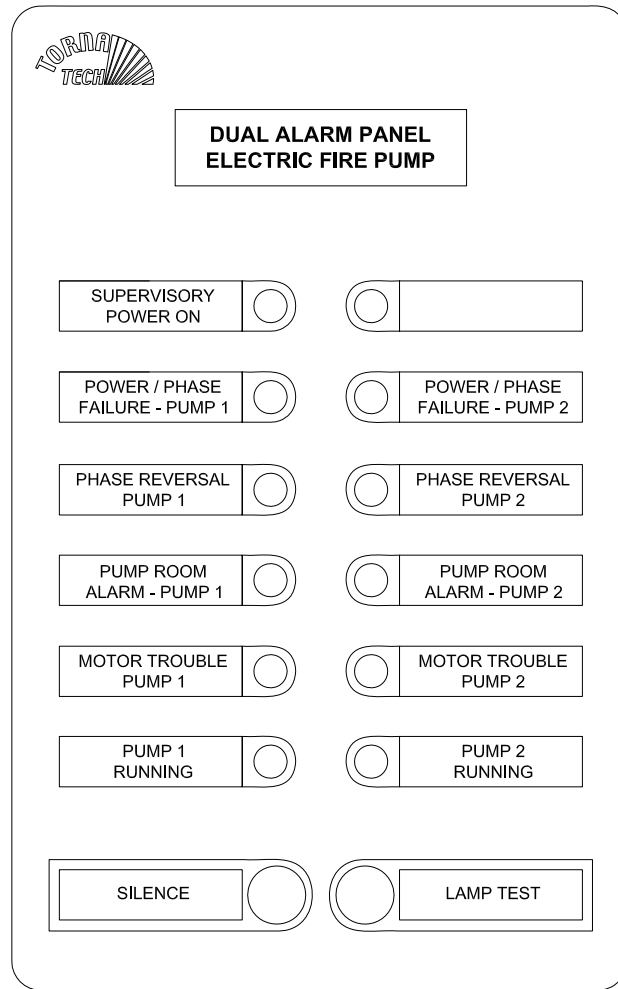

NEMA 1 ENCLOSURE
RED RAL 3002

Drawing for Information only.
Manufacturer reserves the right to modify this drawing without notice.
For drawing for approval or installation, please contact manufacturer.



ISO 9001
REGISTERED



| REV. | DATE dd/mm/yy | DESCRIPTION | APP. |
|------|------------------|------------------|--------|
| 1. | 20/08/13 | GENERAL REVISION | DES. |
| 0. | 12/03/06 | FIRST ISSUE | A VER. |

Drawing No.

APX-0019 2/2 /E