


# ALARM PANEL FOR ELECTRIC & DIESEL FIRE PUMP CONTROLLERS

Schematic

MODEL : APED  
BUILT TO UL 508A STANDARD.

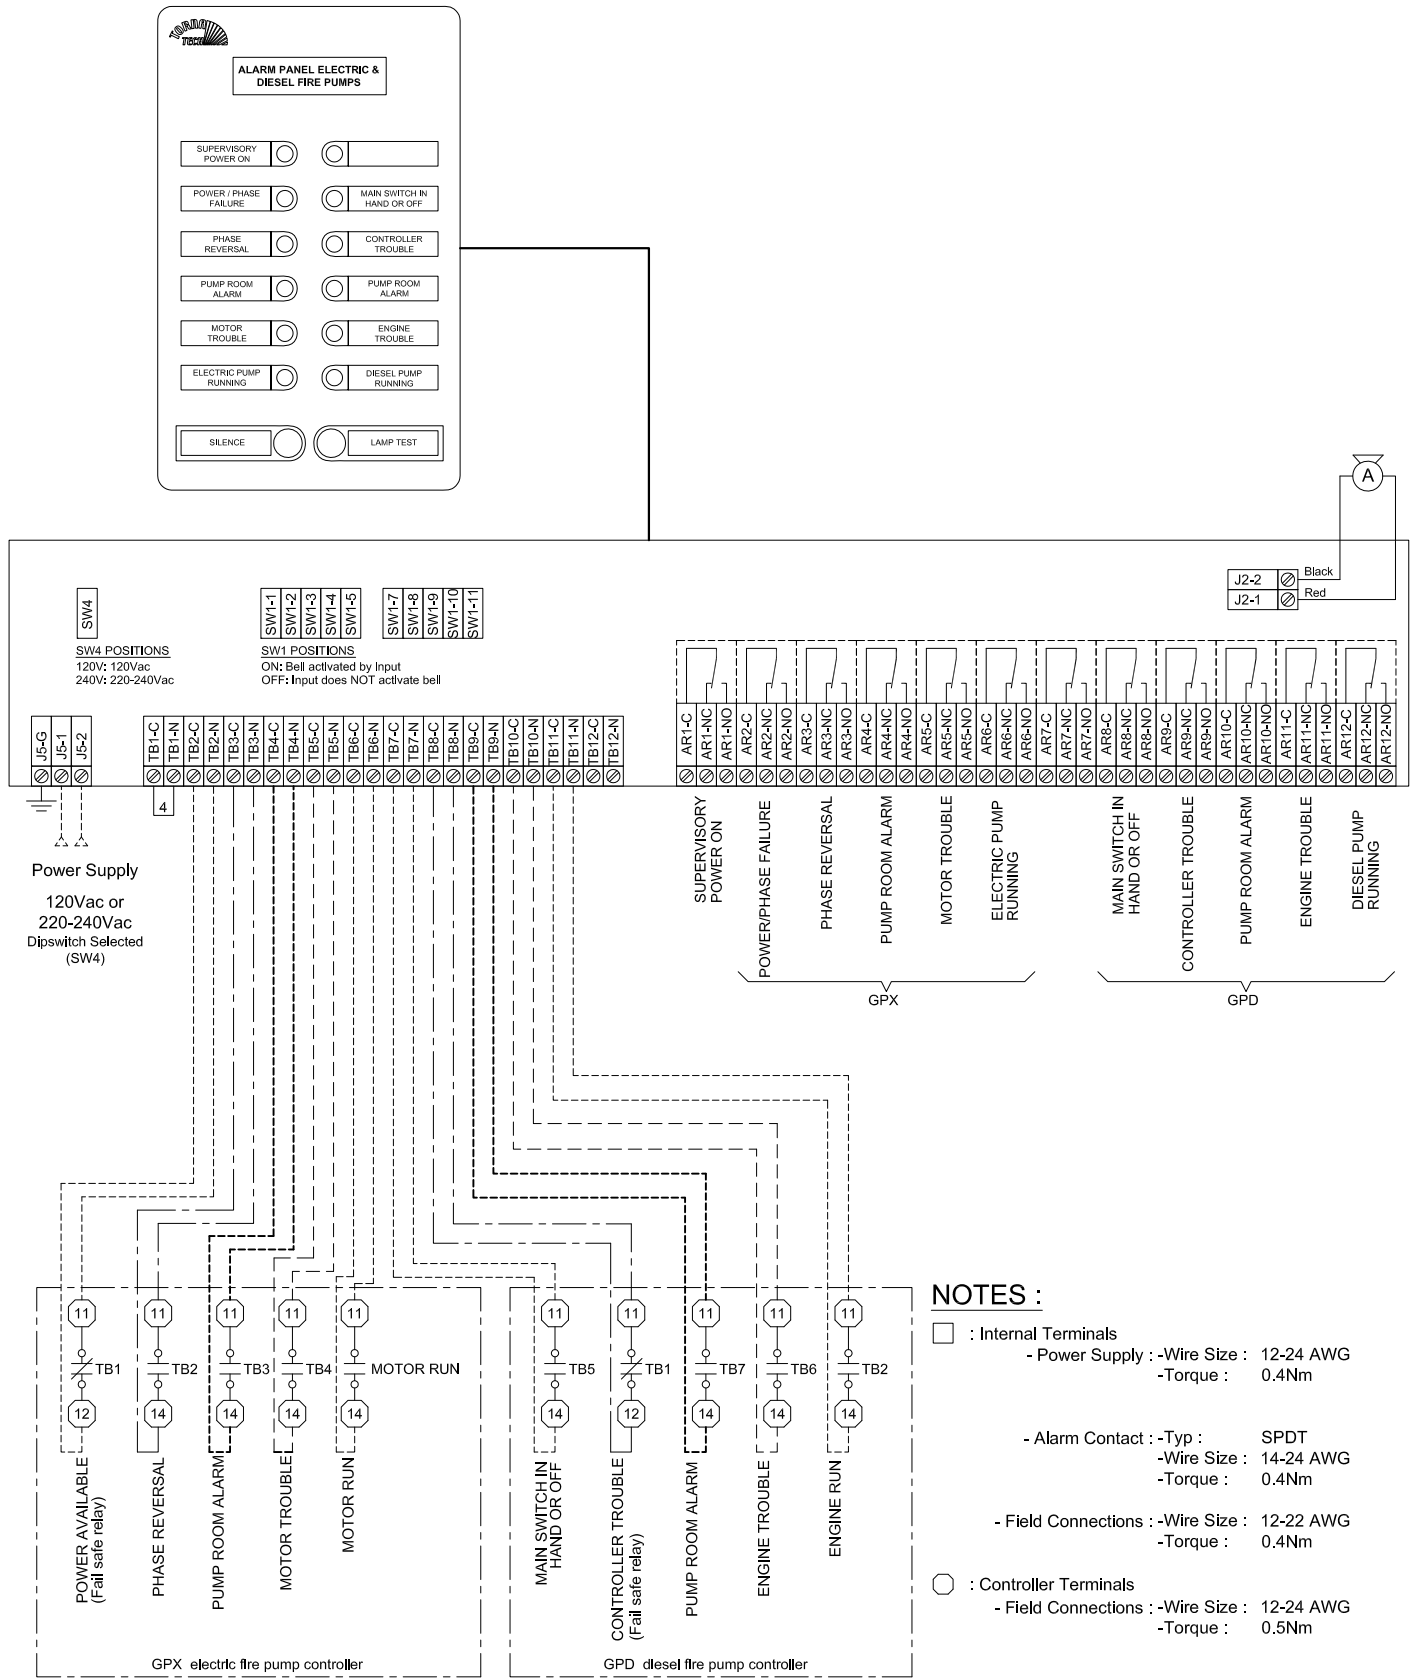

Drawing for Information only.  
Manufacturer reserves the right to modify this drawing without notice.  
For drawing for approval or installation, please contact manufacturer.



ISO 9001 REGISTERED





REV.	DATE	DESCRIPTION	APP.
2.	20/08/13	GENERAL REVISION	
1.	23/05/13	GENERAL REVISION	DES.
0.	23/03/12	FIRST ISSUE	A VER.

Drawing No.  
**APX-0022 1/2 /E**

# ALARM PANEL FOR ELECTRIC & DIESEL FIRE PUMP CONTROLLERS


Dimensions

MODEL : APED  
BUILT TO UL 508A STANDARD.

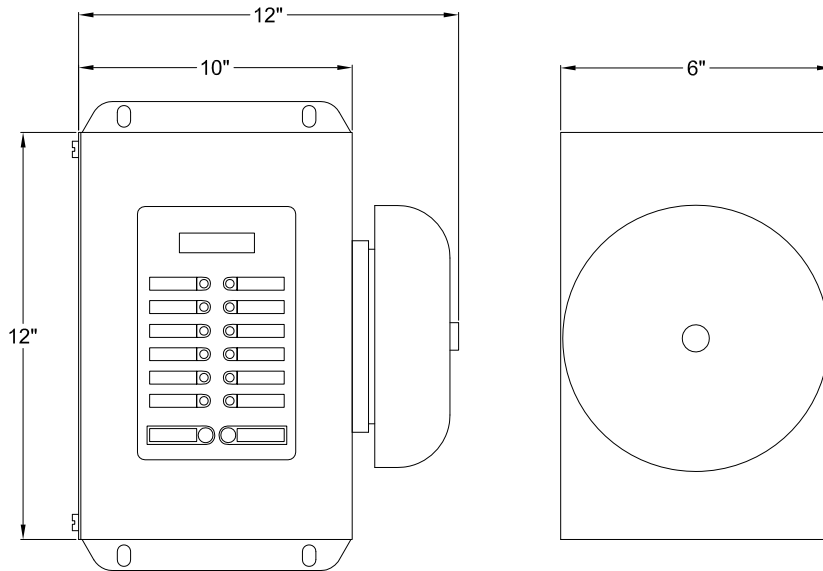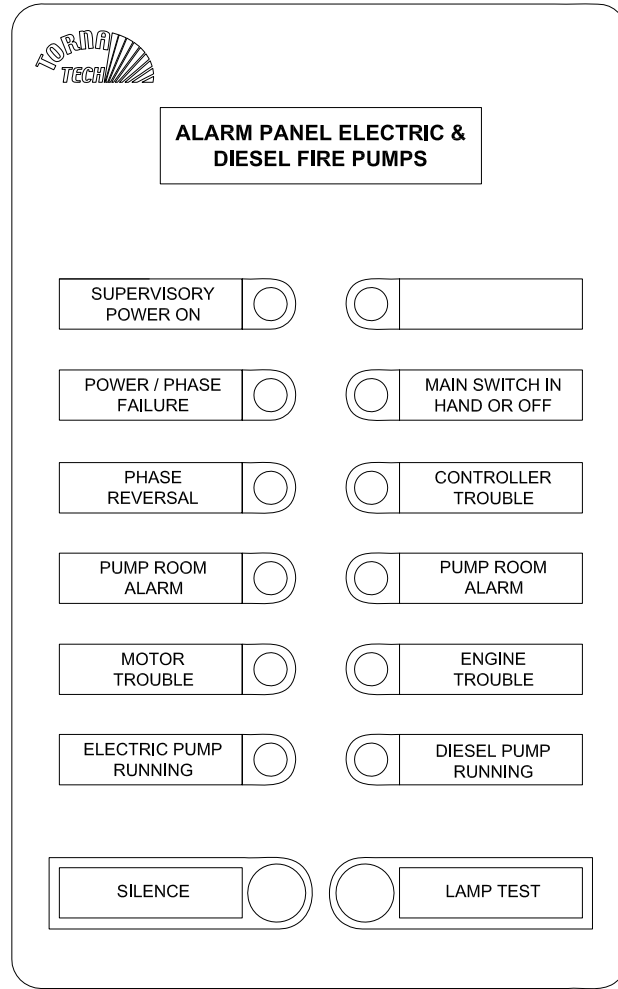

NEMA 1 ENCLOSURE  
RED RAL 3002

Drawing for Information only.  
Manufacturer reserves the right to modify this drawing without notice.  
For drawing for approval or installation, please contact manufacturer.



ISO 9001  
REGISTERED



REV.	DATE	DESCRIPTION	APP.
2.	20/08/13	GENERAL REVISION	
1.	23/05/13	GENERAL REVISION	DES.
0.	23/03/12	FIRST ISSUE	A VER.

Drawing No.

APX-0022 2/2 /E