


ALARM PANEL FOR ELECTRIC FIRE PUMP CONTROLLER

MODEL : APE

Schematic

BUILT TO UL 508A STANDARD.

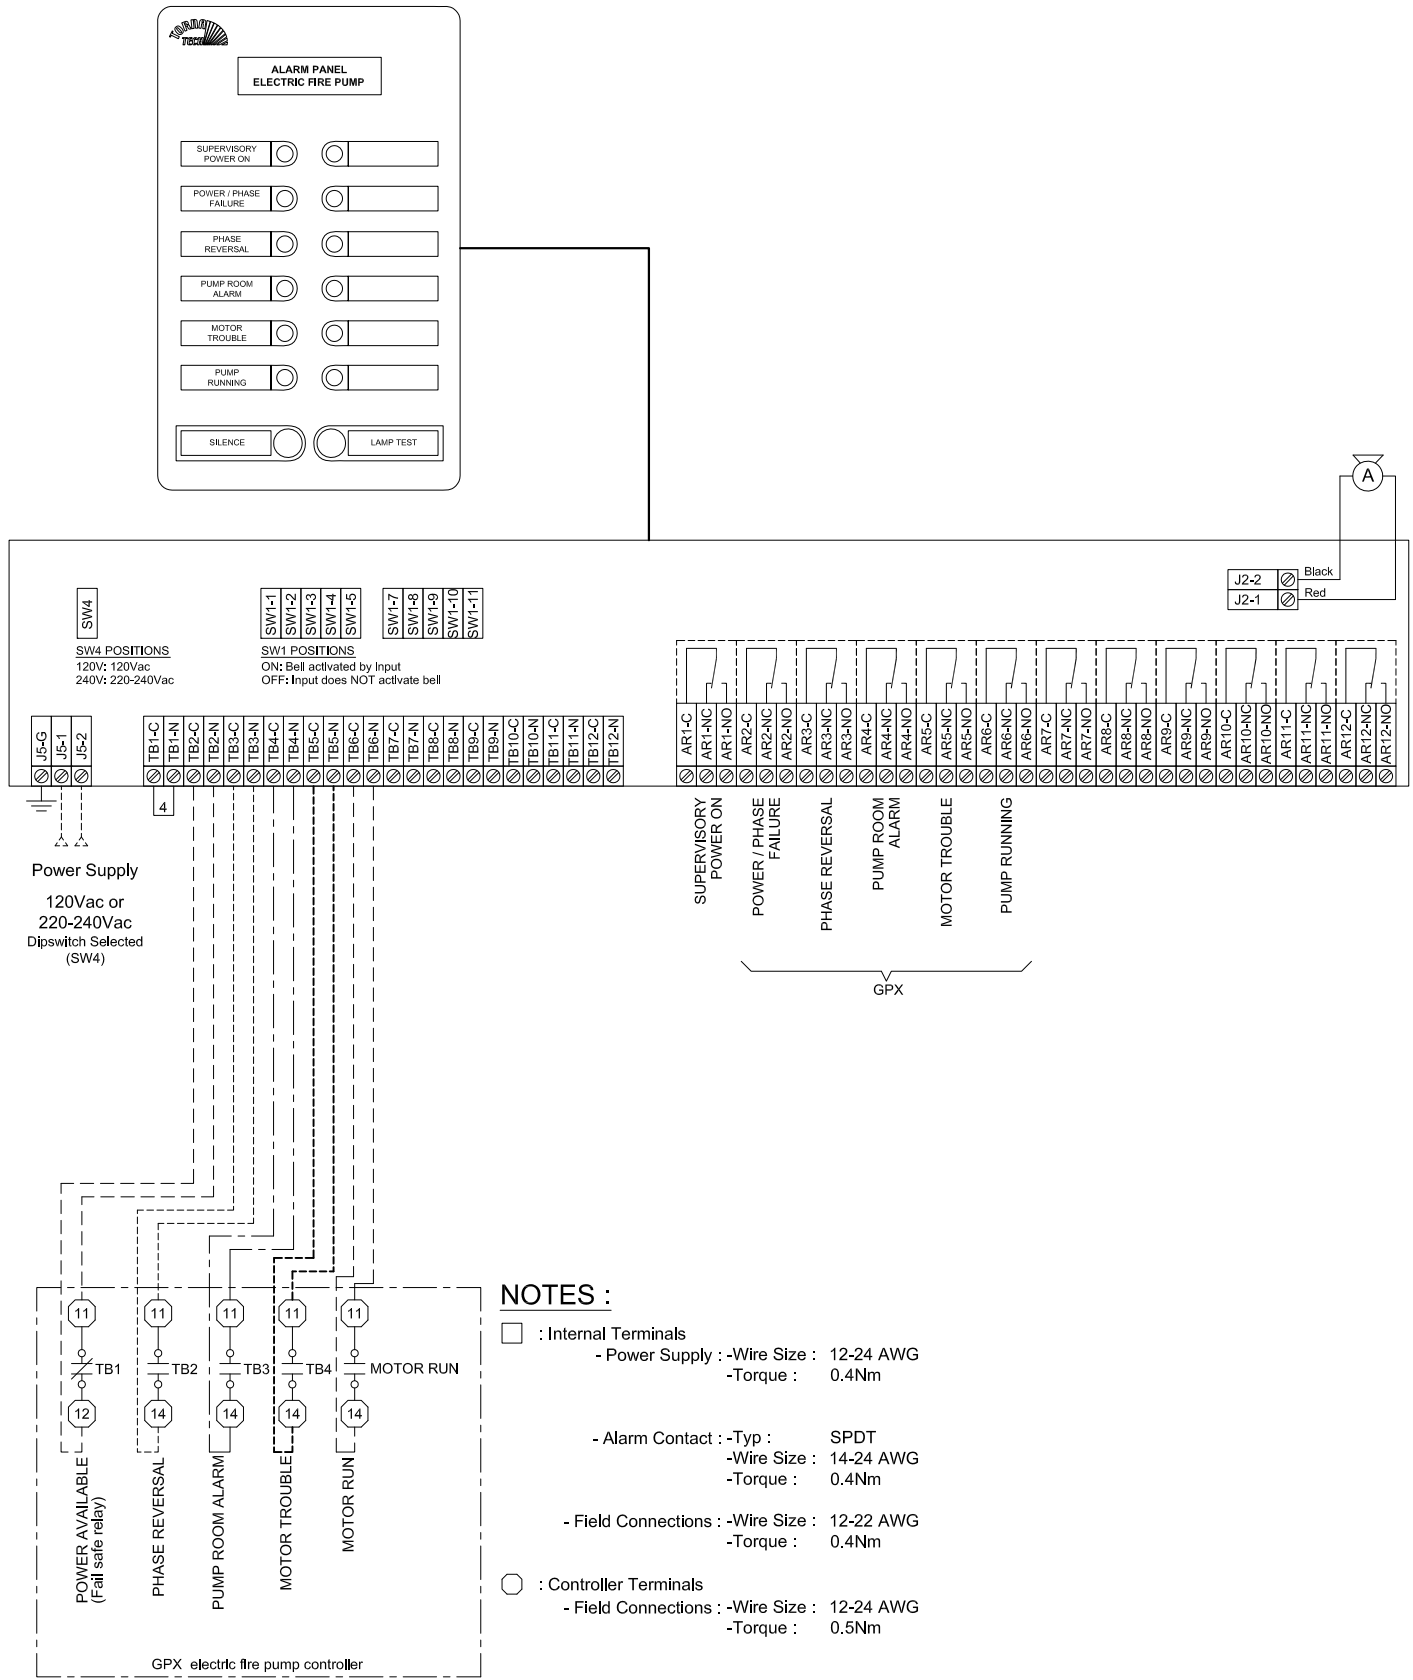

Drawing for Information only.
Manufacturer reserves the right to modify this drawing without notice.
For drawing for approval or installation, please contact manufacturer.



ISO 9001 REGISTERED



1.	20/08/13	GENERAL REVISION	DES.
0.	12/04/05	FIRST ISSUE	A VER.
REV.	DATE	DESCRIPTION	APP.



Drawing No.
APX-0023 1/2 /E

ALARM PANEL FOR ELECTRIC FIRE PUMP CONTROLLER

MODEL : APE

Dimensions

BUILT TO UL 508A STANDARDS.

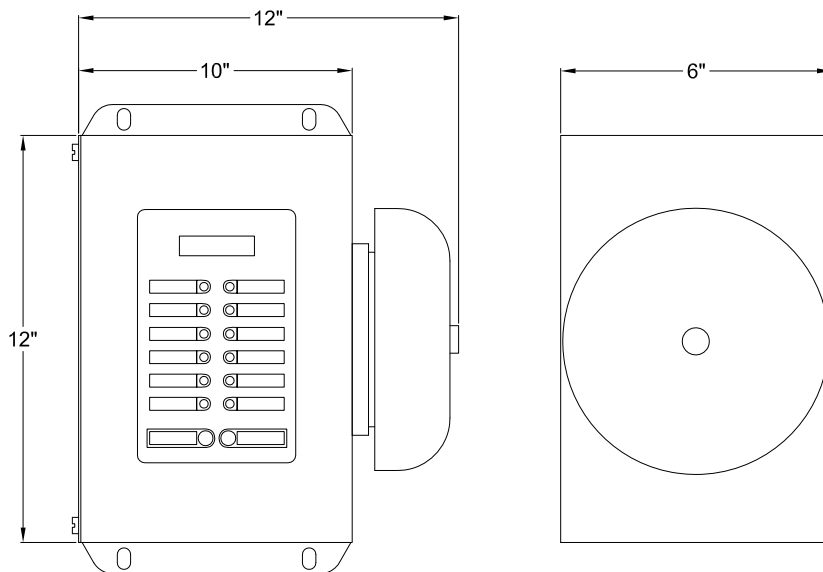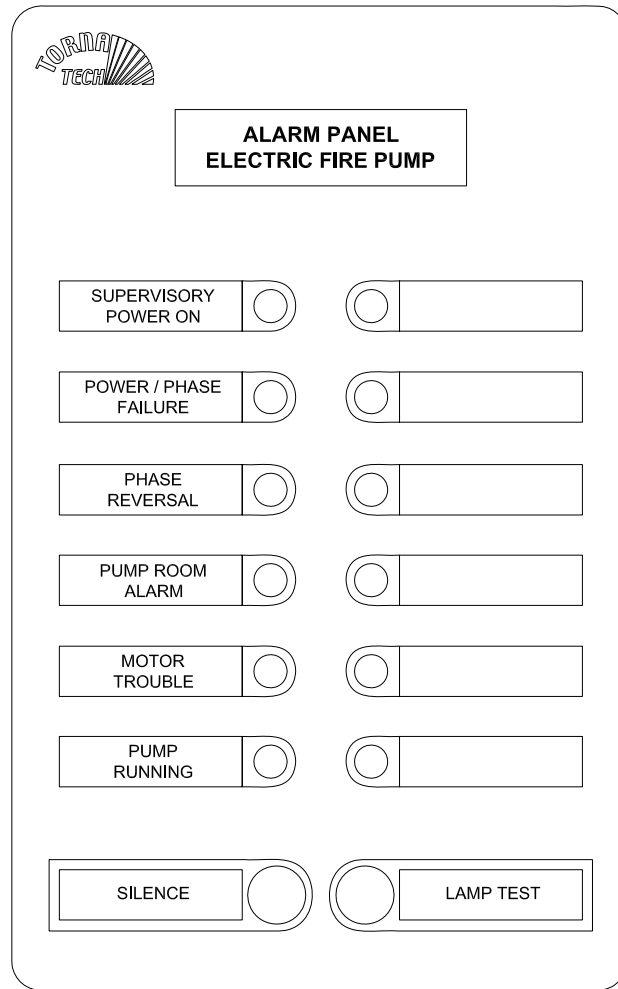

NEMA 1 ENCLOSURE
RED RAL 3002

Drawing for Information only.
Manufacturer reserves the right to modify this drawing without notice.
For drawing for approval or installation, please contact manufacturer.



ISO 9001
REGISTERED



REV.	DATE	DESCRIPTION	APP.
1.	20/08/13	GENERAL REVISION	DES.
0.	12/04/05	FIRST ISSUE	A VER.

Drawing No.

APX-0023 2/2 /E